


NOTES:

- A. Quantity: _____ Oil Water Separator(s).
- B. Material: Carbon Steel per UL-58.
- C. Design & Operating Pressure: Atmospheric.
- D. Design & Operating Temperature: 40 degrees to 120 degree F.
- E. Separator to be Built & Labeled Per UL 2215.
- F. Interior: Abrasive blast and lined with UL listed coating.
- G. Exterior: Corrosion protection per UL1746.
- H. Electronics: To be furnished by separator manufacturer as specified.
- I. All Fittings to be Protected for Shipment.
- J. Customer has the Responsibility to Verify all Dimensions.

NOZZLE SCHEDULE

QTY.	ITEM	SIZE	RATING	TYPE	MATL.	PROJ. IN	PROJ. OUT								NOTES
1	A	24"	PRESSED	MANWAY	C.S.	1/4"									VENT
1	B	24"	PRESSED	MANWAY	C.S.	1/4"	AS SHWN.								SLUDGE REMOVAL
2	C	2"	STD. NPT.	HF. CPLG.	C.S.	0"	AS SHWN.								VENT
1	D	6"	150# FLG.	S.O.R.F.	C.S.	1/4"	AS SHWN.								INLET
1	E	6"	150# FLG.	S.O.R.F.	C.S.	1/4"	AS SHWN.								OUTLET
2	F	1"	STD. NPT.	HF. CPLG.	C.S.	0"	AS SHWN.								VENT
1	G	2"	STD. NPT.	HF. CPLG.	C.S.	1/4"	AS SHWN.								OIL LEVEL CONTROL
1	H	2"	STD. NPT.	HF. CPLG.	C.S.	1/4"	AS SHWN.								OIL PUMP OUT
1	J	6"	STD. NPT.	"V"	C.S.	0"	0"								DIFFUSER

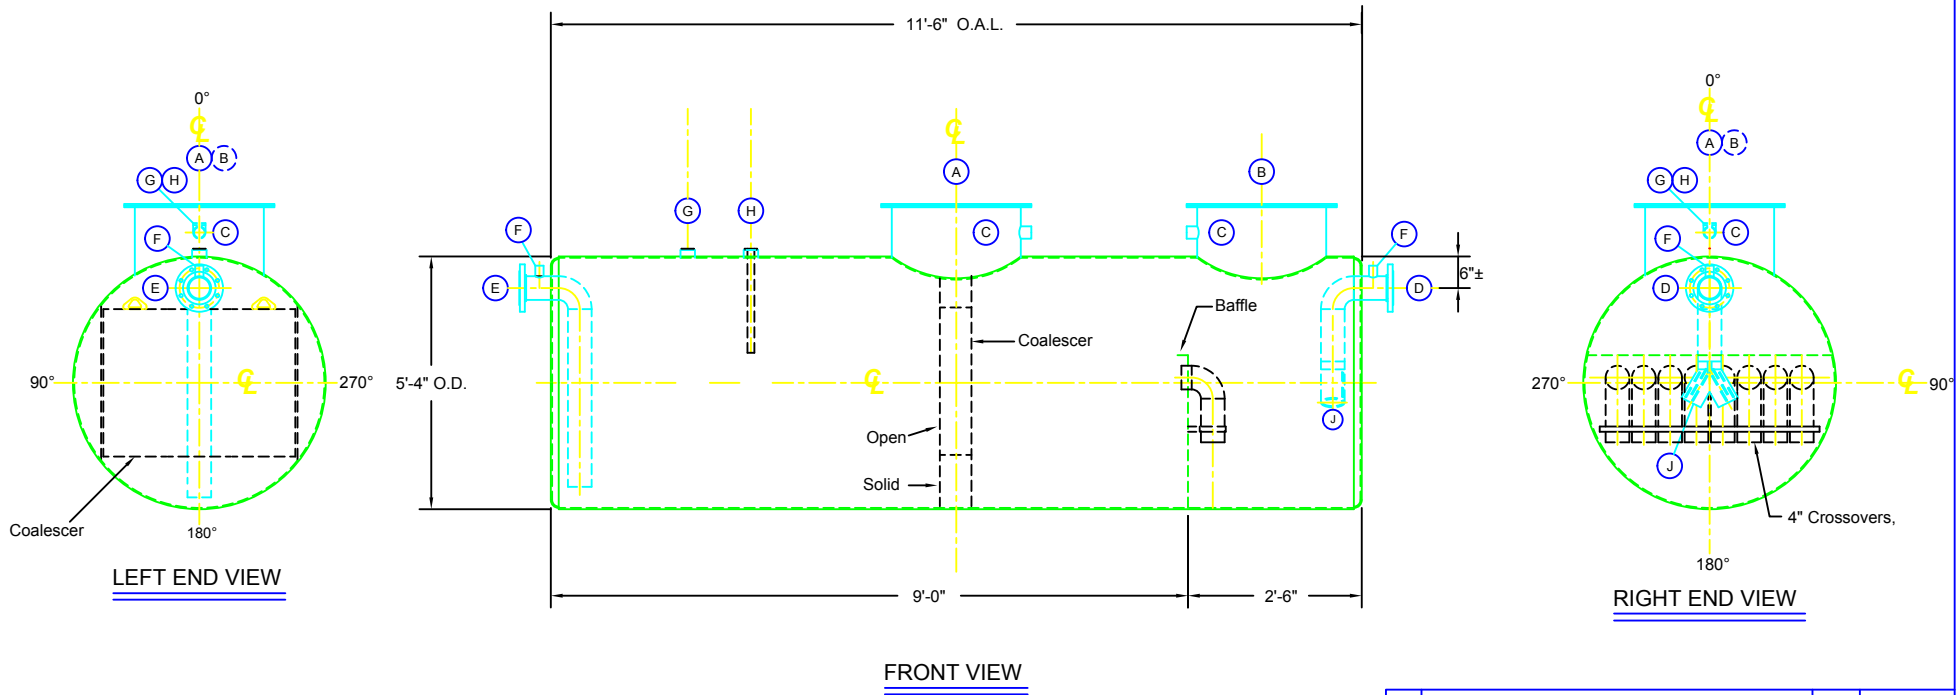

NO.	DESCRIPTION	DATE	NAME
REVISIONS			
Modern Welding Company			
VESSEL DESCRIPTION: 1,500 Gallon KleerWater Oil Water Separator Tank			
CUSTOMER:			P.O.#
DATE:	SCALE: N.T.S.	DWG.# VOWS1500KW	DRAWN BY: CHKD. BY: