




PLAN VIEW

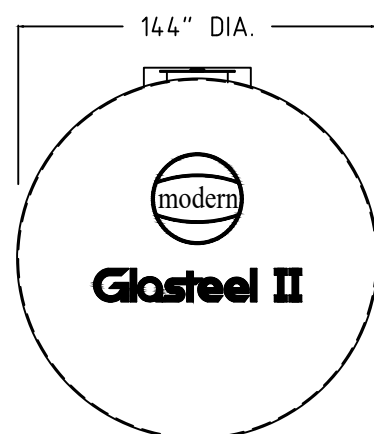

END VIEW

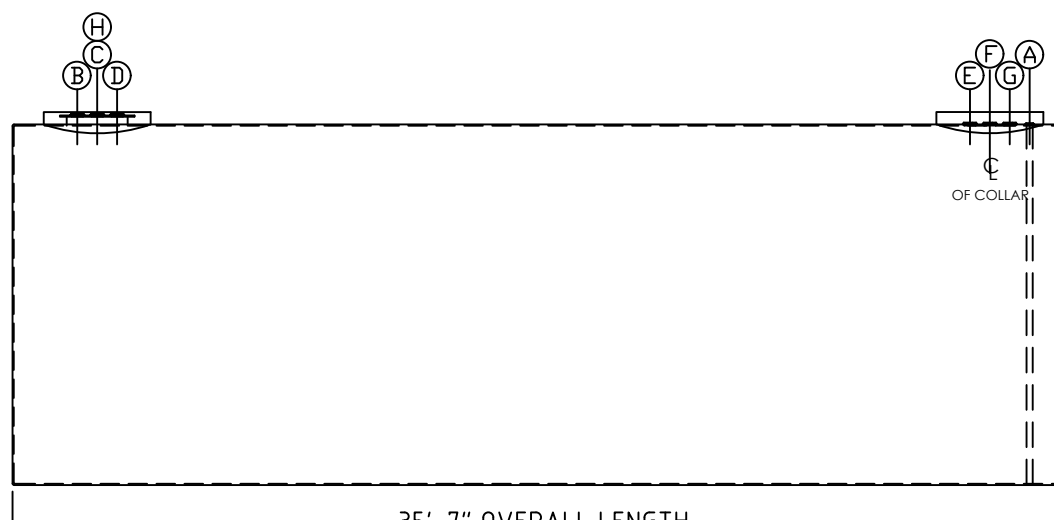

ELEVATION VIEW

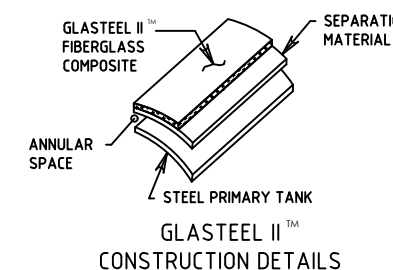

INTERIOR: BARE, CLEAN OF DEBRIS

EXTERIOR: F.R.P.

MARK	QTY.	SIZE	TYPE	REMARKS
H	1	24"		MANWAY
G	1	4"	FNPT	
F	1	4"	FNPT	
E	1	4"	FNPT	
D	1	4"	FNPT	
C	1	4"	FNPT	
B	1	4"	FNPT	
A	1	2"	FNPT	MONITOR
SCHEDULE OF OPENINGS				

DESIGN : FABRICATED PER UL 1746 SPECIFICATIONS
 MEETS NFPA 30 & 31 REQUIREMENTS
 MEETS EPA 280.20 REQUIREMENTS
 METHANOL COMPATIBLE PER RULE 1170

INSPECTION : MODERN WELDING COMPANY
 MATERIAL : MILD CARBON STEEL (UNLESS NOTED)
 INTERNAL SURFACE PREP.-CLEAN OF DEBRIS
 EXTERNAL SURFACE PREP - SSPC-SP6
 COATING : 100 MIL. MIN. F.R.P.

OPERATING PRESSURE : ATMOSPHERIC
 THIS TANK ARRIVES AT THE JOBSITE UNDER VACUUM AND DOES NOT
 REQUIRE FURTHER INTEGRITY TESTS. IF JOBSITE AIR PRESSURE TEST
 REQUIRED THE PRIMARY (INNER) TANK MAY BE PRESSURIZED UP TO 5 P.S.I.
 THE SECONDARY (OUTER) TANK MAY BE TESTED BY VACUUM ONLY. THE
 OUTER TANK RECEIVES A 35,000 VOLTS HOLIDAY TEST AT
 THE FACTORY

GENERAL NOTES

THIS DRAWING IF FOR ILLUSTRATION PURPOSES ONLY AND IS NOT TO BE RELIED UPON FOR ANY OTHER PURPOSE. NO WARRANTY OF MERCHANTABILITY, OF FITNESS FOR A PARTICULAR PURPOSE, OR OF ANY OTHER KIND, EXPRESSED OR IMPLIED IS HEREBY MADE.

MODERN WELDING COMPANY, INC.

GLASTEEL II JACKETED UNDERGROUND TANK

TANK NOM. CAPACITY : 30,000 GALLON

DWN. BY	DATE:	SCALE: NONE
CHK. BY	JOB NO.	DWG. NO.
APR. BY	P.O. NO.	SHT. NO. 1 OF 1