





PLAN VIEW

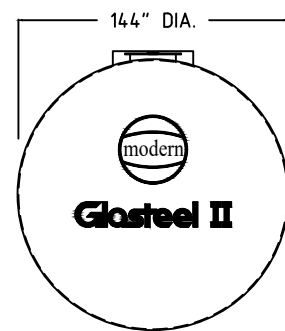


END VIEW

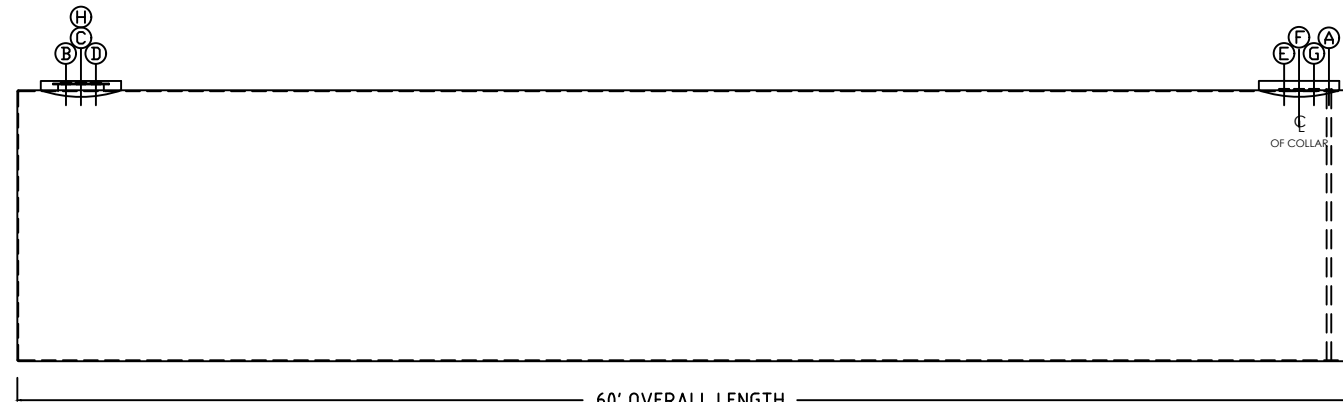

60' OVERALL LENGTH

ELEVATION VIEW

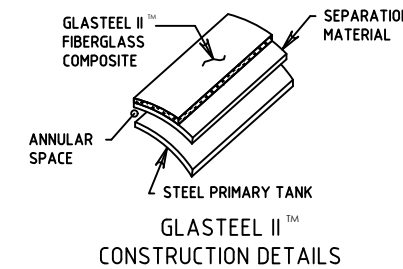

INTERIOR: BARE, CLEAN OF DEBRIS

EXTERIOR: F.R.P.

MARK	QTY.	SIZE	TYPE	REMARKS
H	1	24"		MANWAY
G	1	4"	FNPT	
F	1	4"	FNPT	
E	1	4"	FNPT	
D	1	4"	FNPT	
C	1	4"	FNPT	
B	1	4"	FNPT	
A	1	2"	FNPT	MONITOR
SCHEDULE OF OPENINGS				


DESIGN : FABRICATED PER UL 1746 SPECIFICATIONS  
 MEETS NFPA 30 & 31 REQUIREMENTS  
 MEETS EPA 280.20 REQUIREMENTS  
 METHANOL COMPATIBLE PER RULE 1170

INSPECTION : MODERN WELDING COMPANY  
 MATERIAL : MILD CARBON STEEL (UNLESS NOTED)  
 INTERNAL SURFACE PREP.-CLEAN OF DEBRIS  
 EXTERNAL SURFACE PREP - SSPC-SP6  
 COATING : 100 MIL. MIN. F.R.P.

OPERATING PRESSURE : ATMOSPHERIC  
 THIS TANK ARRIVES AT THE JOBSITE UNDER VACUUM AND DOES NOT  
 REQUIRE FURTHER INTEGRITY TESTS. IF JOBSITE AIR PRESSURE TEST  
 REQUIRED THE PRIMARY (INNER) TANK MAY BE PRESSURIZED UP TO 5 P.S.I.  
 THE SECONDARY (OUTER) TANK MAY BE TESTED BY VACUUM ONLY. THE  
 OUTER TANK RECEIVES A 35,000 VOLTS HOLIDAY TEST AT  
 THE FACTORY


GENERAL NOTES

THIS DRAWING IS FOR ILLUSTRATION PURPOSES ONLY AND IS NOT TO BE RELIED UPON FOR ANY OTHER PURPOSE. NO WARRANTY OF MERCHANTABILITY, OF FITNESS FOR A PARTICULAR PURPOSE, OR OF ANY OTHER KIND, EXPRESSED OR IMPLIED IS HEREBY MADE.

 MODERN WELDING COMPANY, INC.

GLASTEEL II JACKETED UNDERGROUND TANK

TANK NOM. CAPACITY : 50,000 GALLON

DWN. BY	DATE:	SCALE: NONE
CHK. BY	JOB NO.	DWG. NO. 
APR. BY	P.O. NO.	SHT. NO. 1 OF 1